


**Large Contingency with Spare Fossil Generation On Line
 Loss of 501 MW and Demand Increase of 277 MW for Net Ramp Need of 778 MW
 February 14, 2006, Delivery Hour 16**



Large Contingency with No Spare Fossil Generation On Line
 Loss of 216 MW of Imports and 480 MW Derating of Gas-Unit
 December 14, 2005, Delivery Hour 8

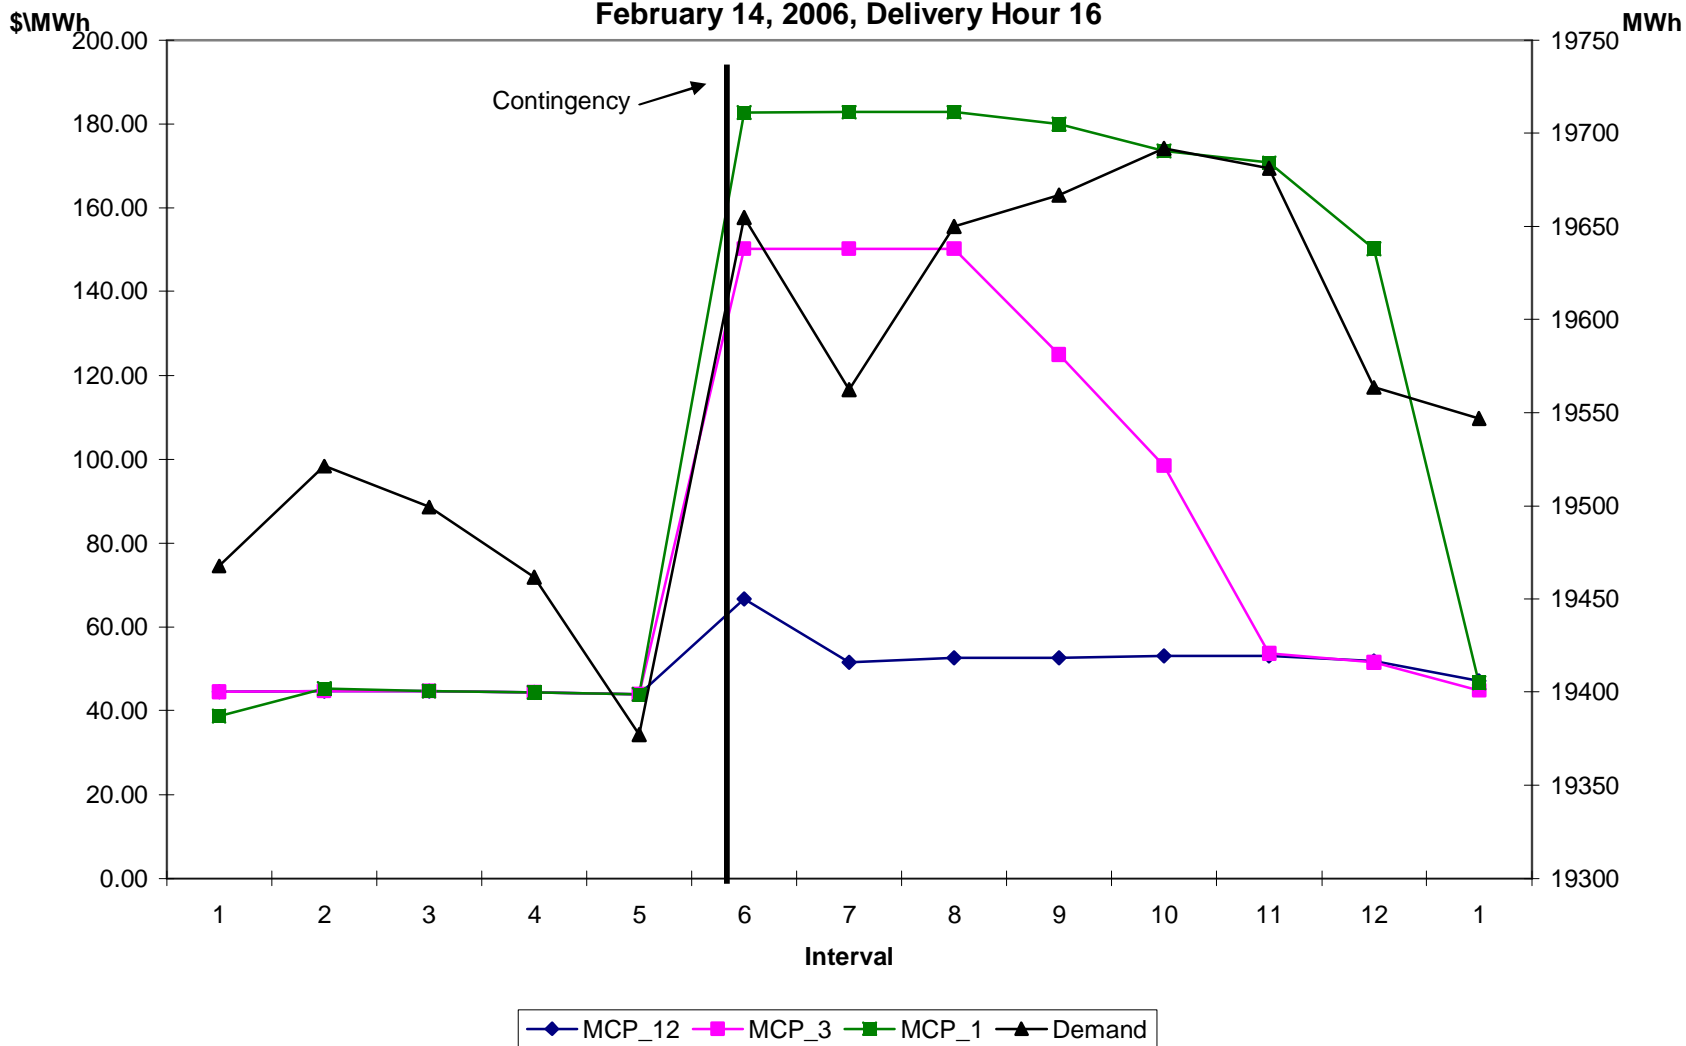